



Pos.	Description
	EXPANSION VESSEL - DHW
1	EXTERNAL UNIT HHP - MONOBLOC 1 -PH OR 3-PH
2	LIGHTBOX
3	SYSTEM INTERFACE
4	LIGHT GATEWAY
5	EXTERNAL PROBE
6	KIT ANTI-FREEZE
9	UNDER FLOOR HEATING
13	FANCOIL COOLING
14	BY-PASS VALVE
15	HEATING-COOLING 3-WAY VALVE

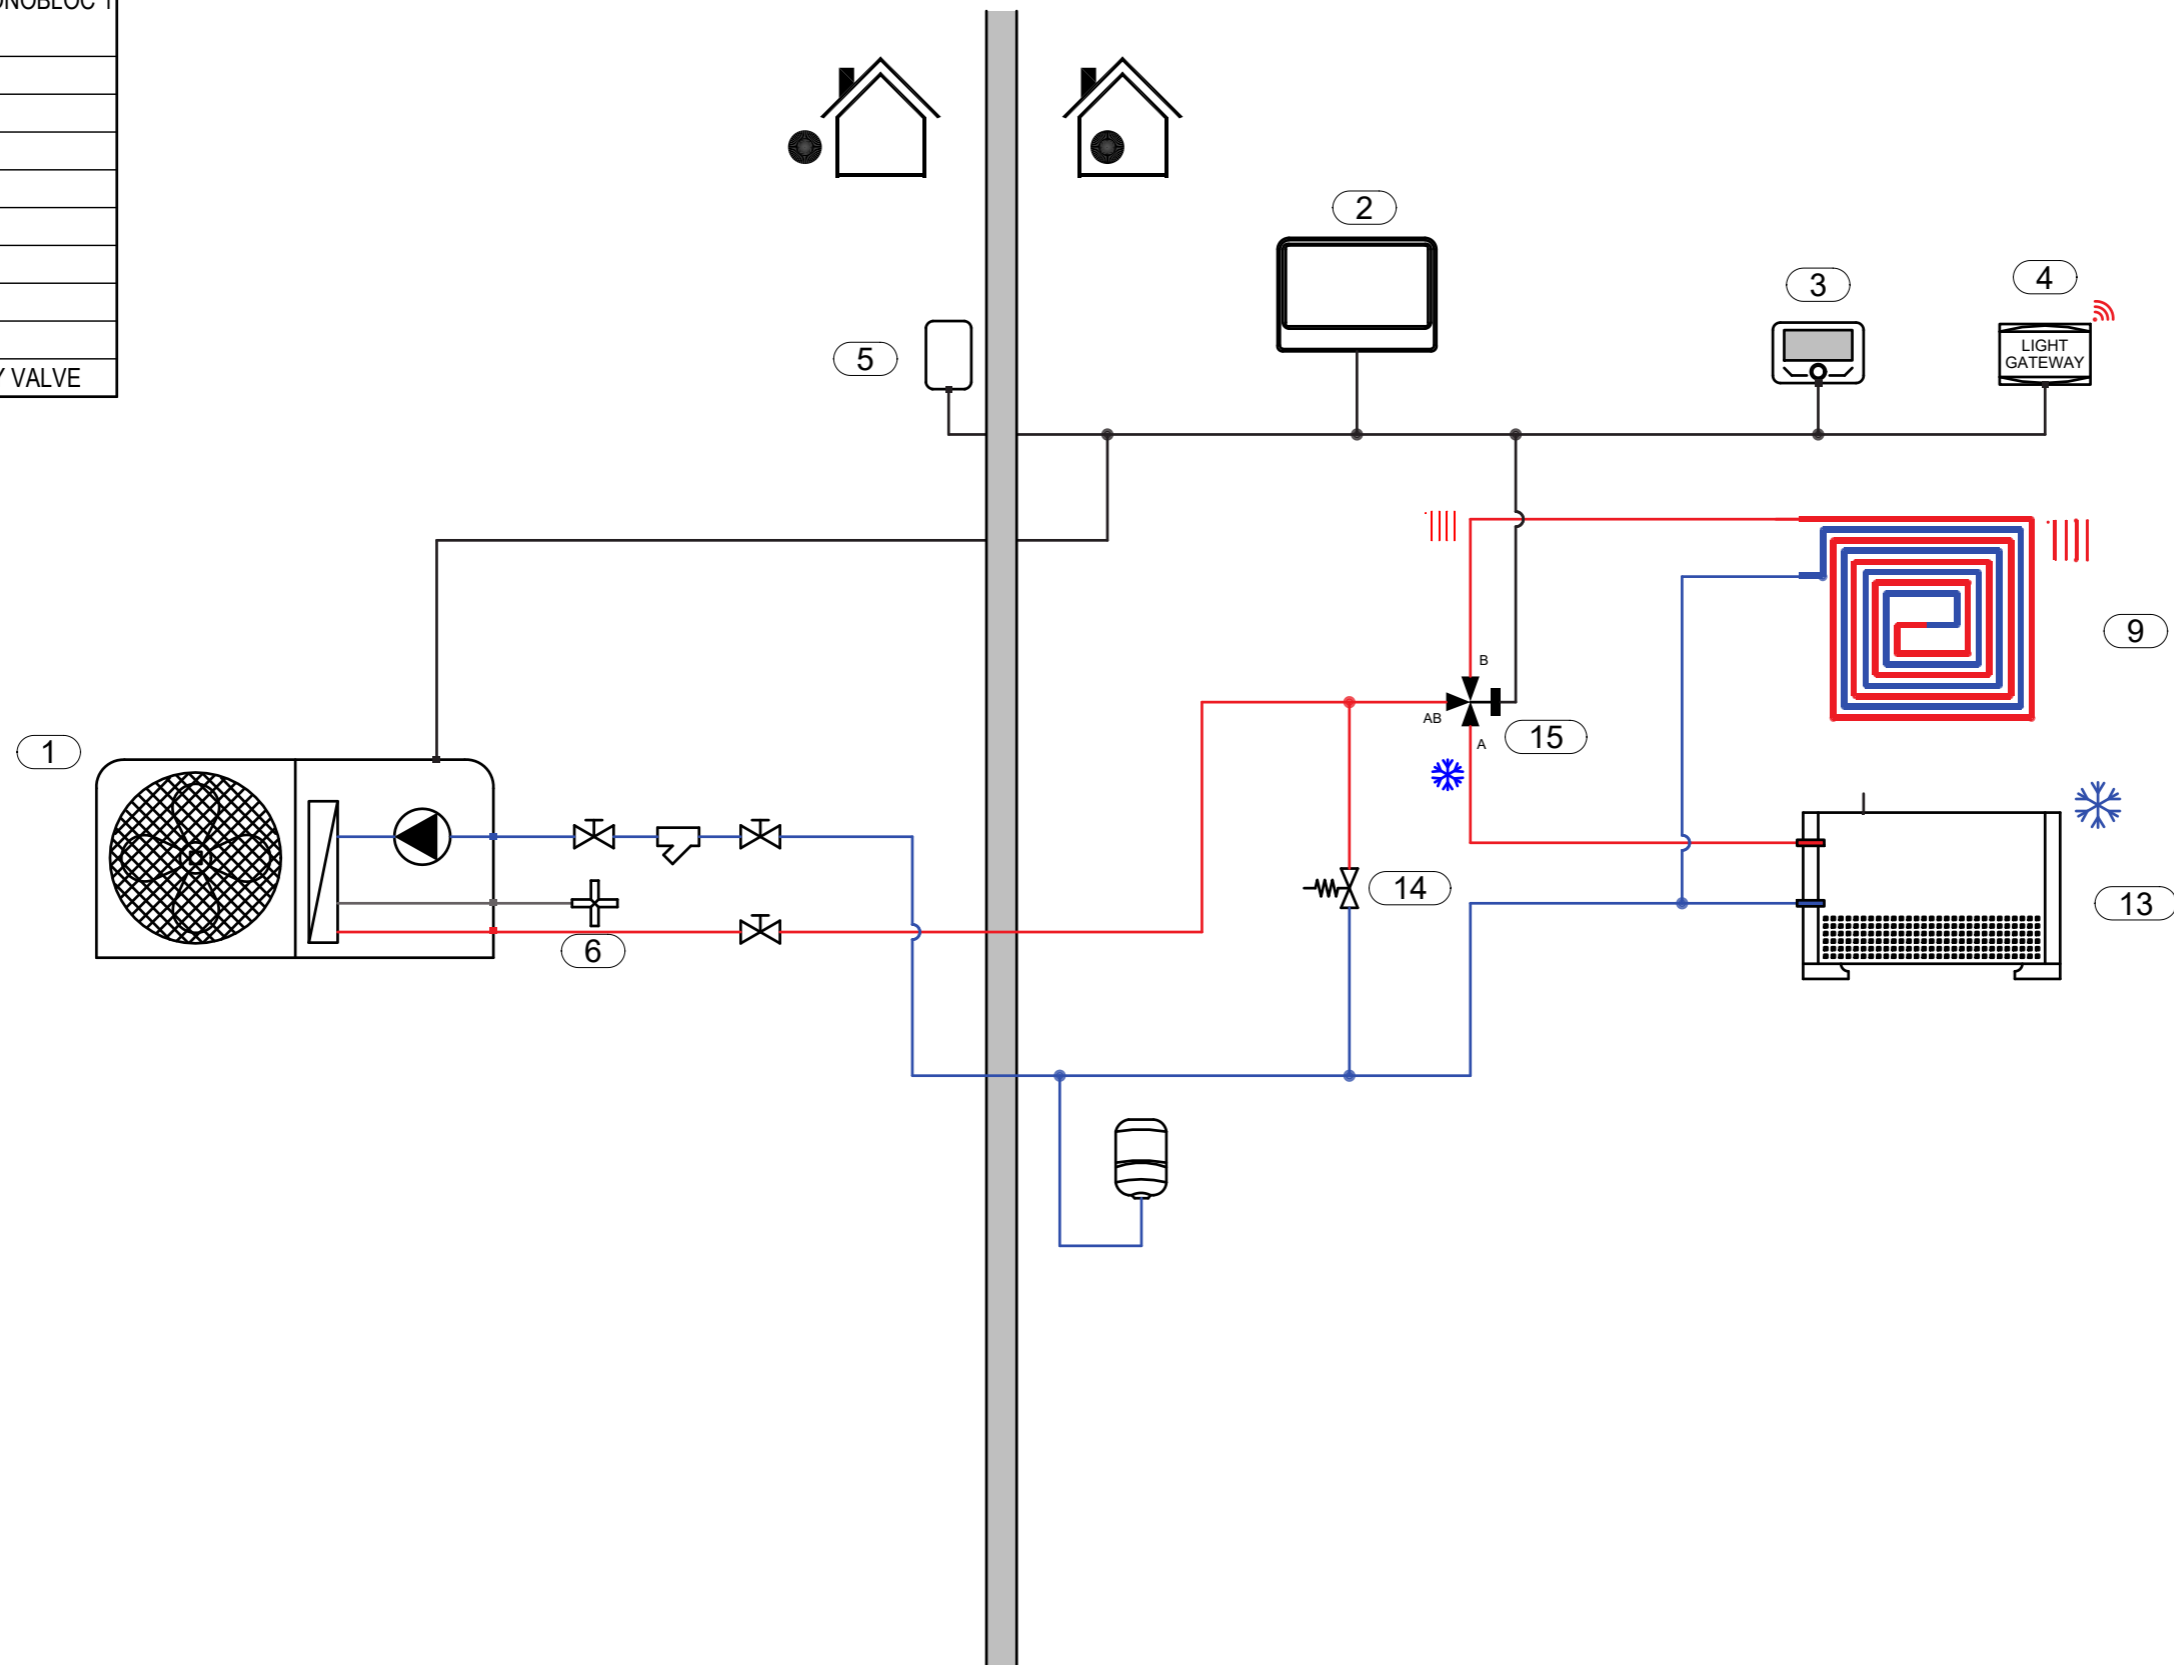

Pos.	Description
	EXPANSION VESSEL - DHW
1	EXTERNAL UNIT HHP - MONOBLOC 1-PH OR 3-PH
2	LIGHTBOX
3	SYSTEM INTERFACE
4	LIGHT GATEWAY
5	EXTERNAL PROBE
6	KIT ANTI-FREEZE
9	UNDER FLOOR HEATING
13	FANCOIL COOLING
14	BY-PASS VALVE
15	HEATING-COOLING 3-WAY VALVE

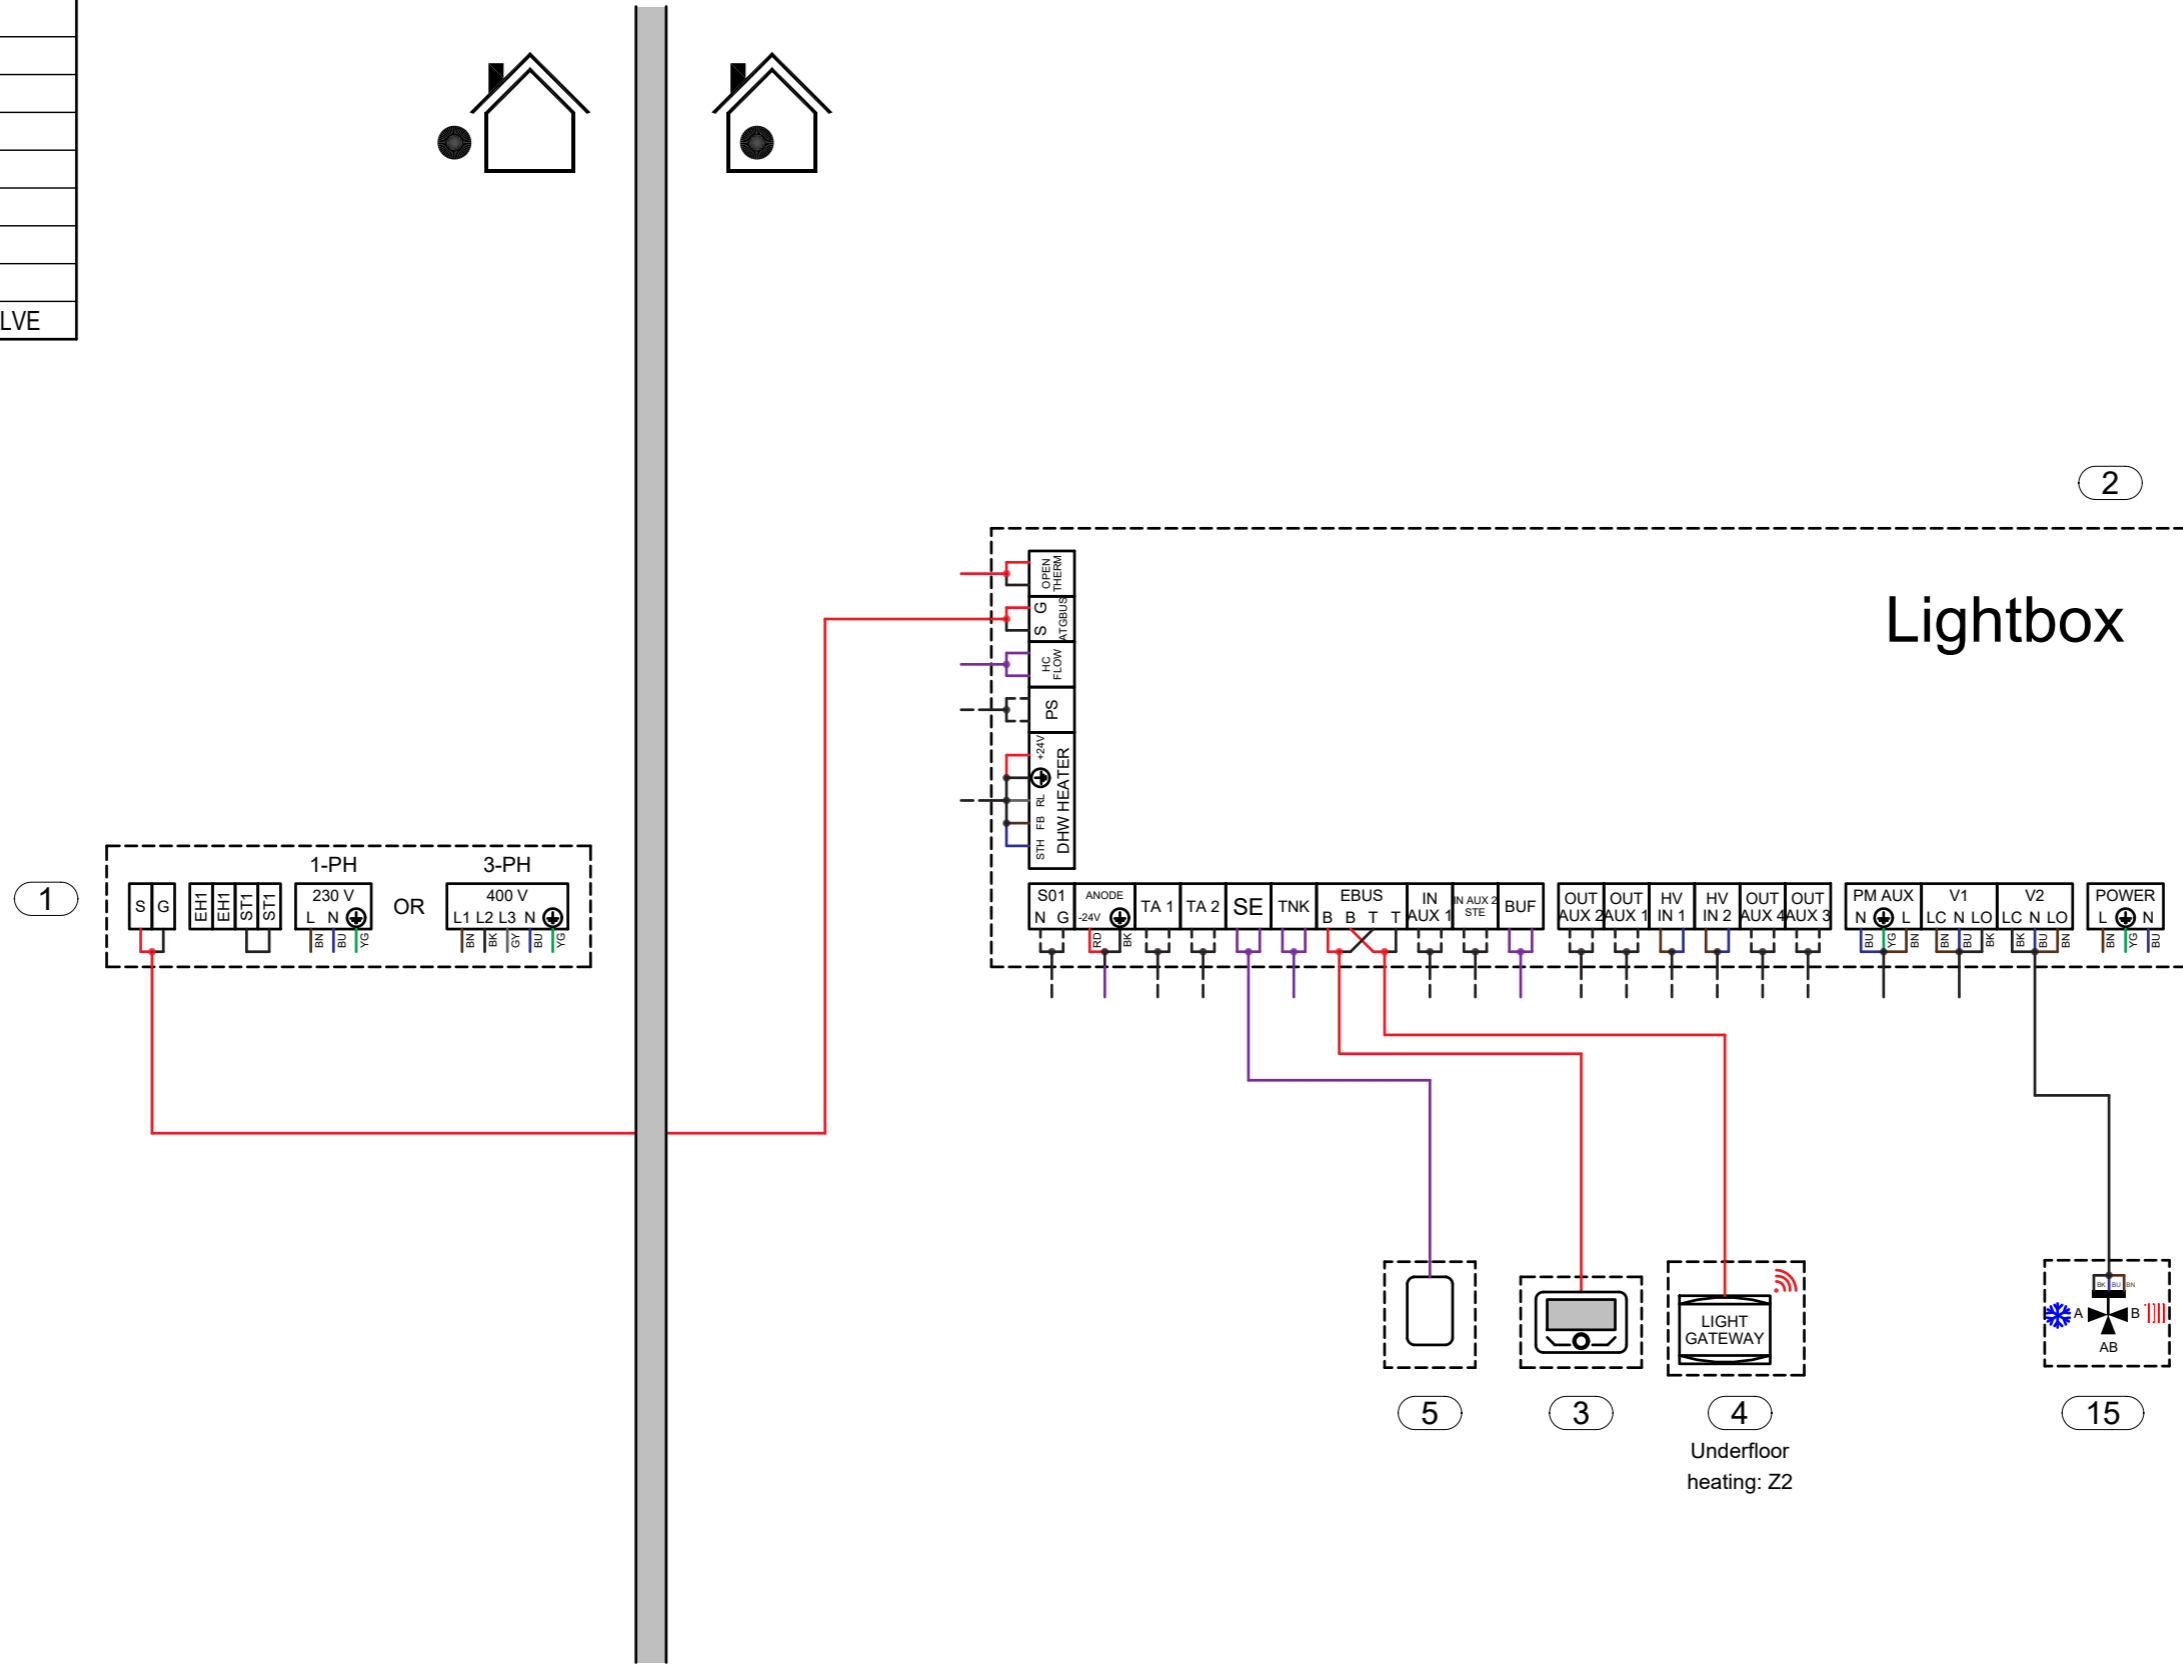

- This schematic is for example only and does not replace design by a qualified technician;
- The final schematic must be prepared respecting all the laws, norms and decrees in force, in order to facilitate a correct installation in compliance with the rule of the art;
- For the proper functioning of all system components, follow the instructions in the design, installation and user manuals provided by the manufacturer;
- This outline may be amended by the Ariston Group at any time without prior notice.

SCHEME Electrical		
DATE 31.8.2023.	REV.	PAGE 2 / 3

SCHEME NAME
EN_014_PCM4.PK_HCD_CD1_BUF.2_1D